


U773.11

UNDERGROUND STANDARD
JUN 2016

OG&E Electric Services[®]

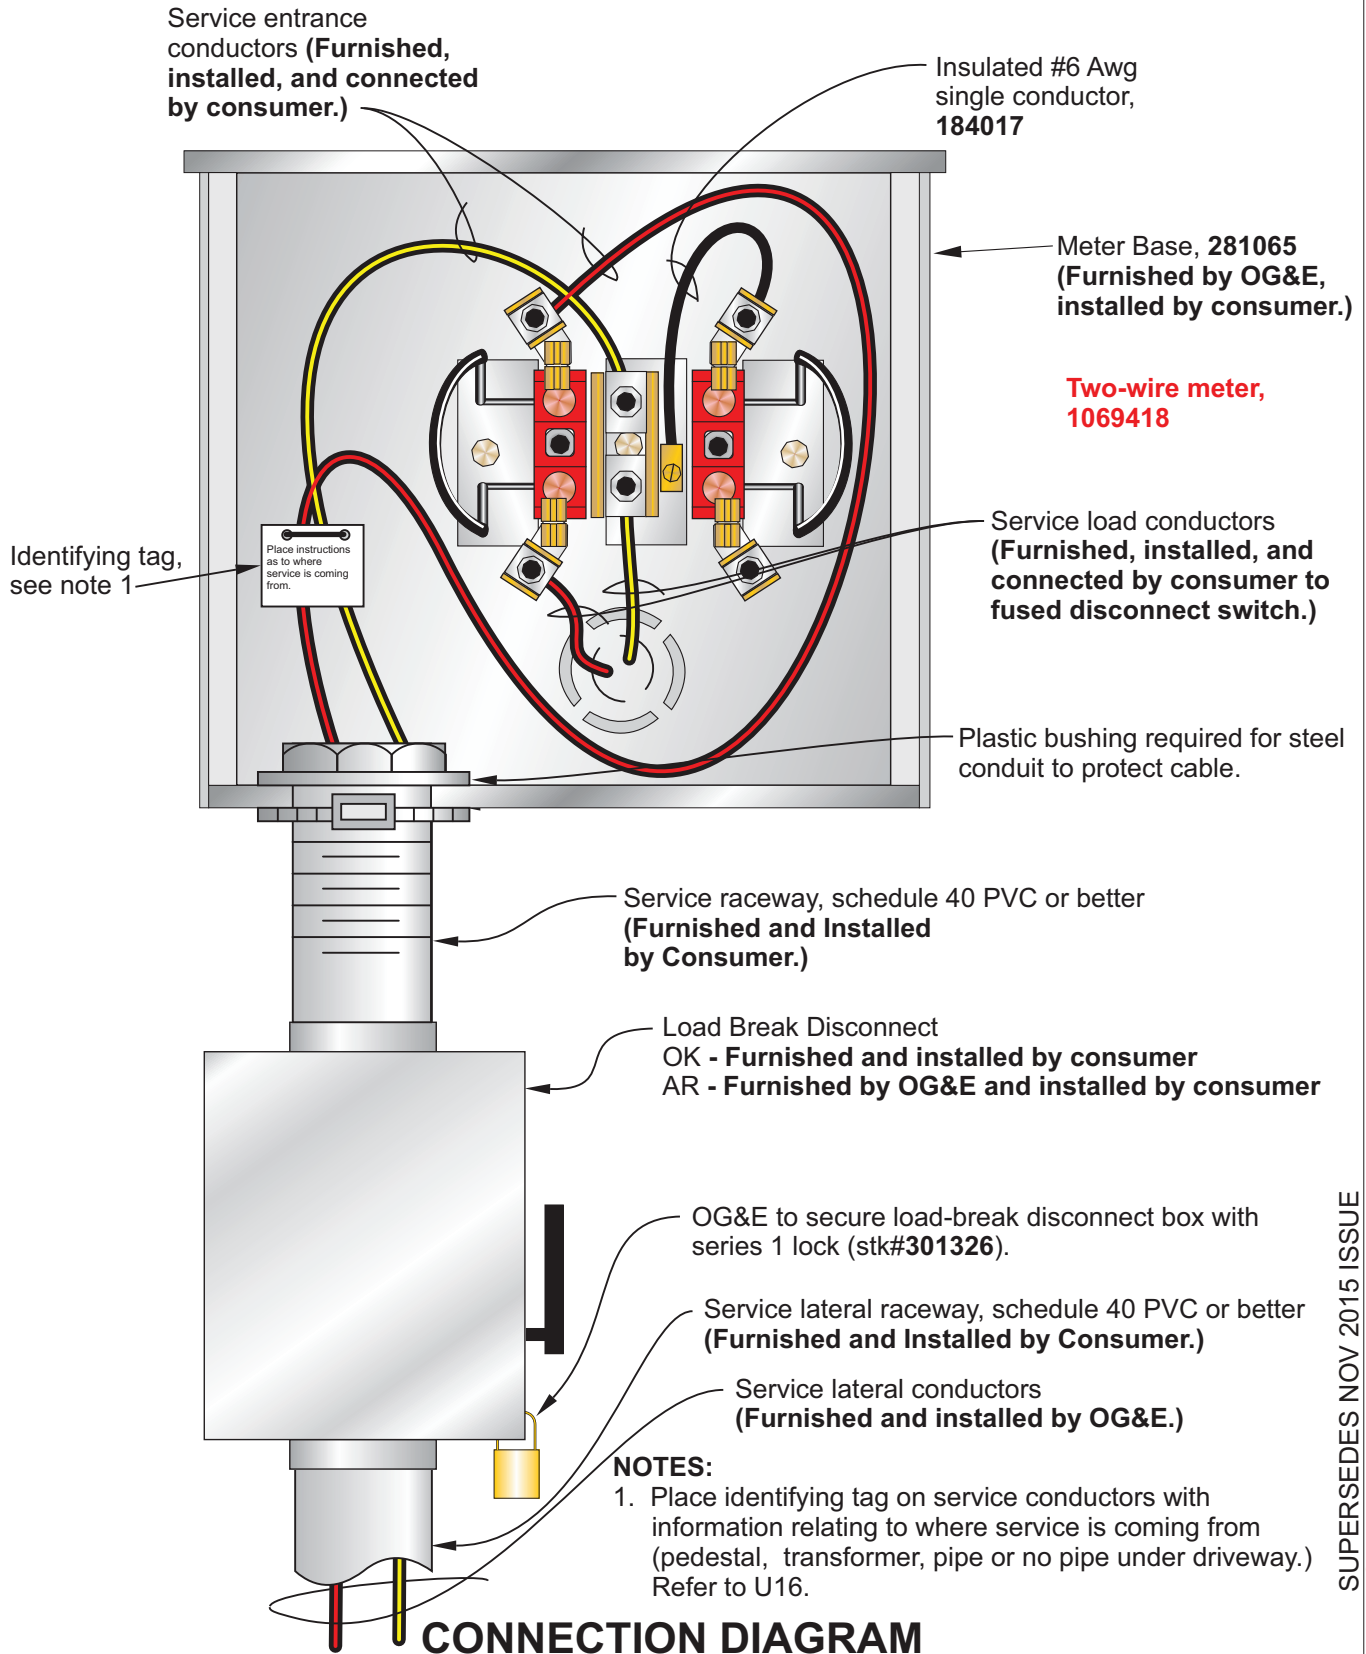

CONNECTION DIAGRAM
FOR SELF-CONTAINED SINGLE PHASE
480-VOLT TWO-WIRE SERVICE 200-AMPERE MAXIMUM

APPROVED **Signatures on File** SUPERSEDES NOV 2015 ISSUE

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.