


U762.3

MAR 2006

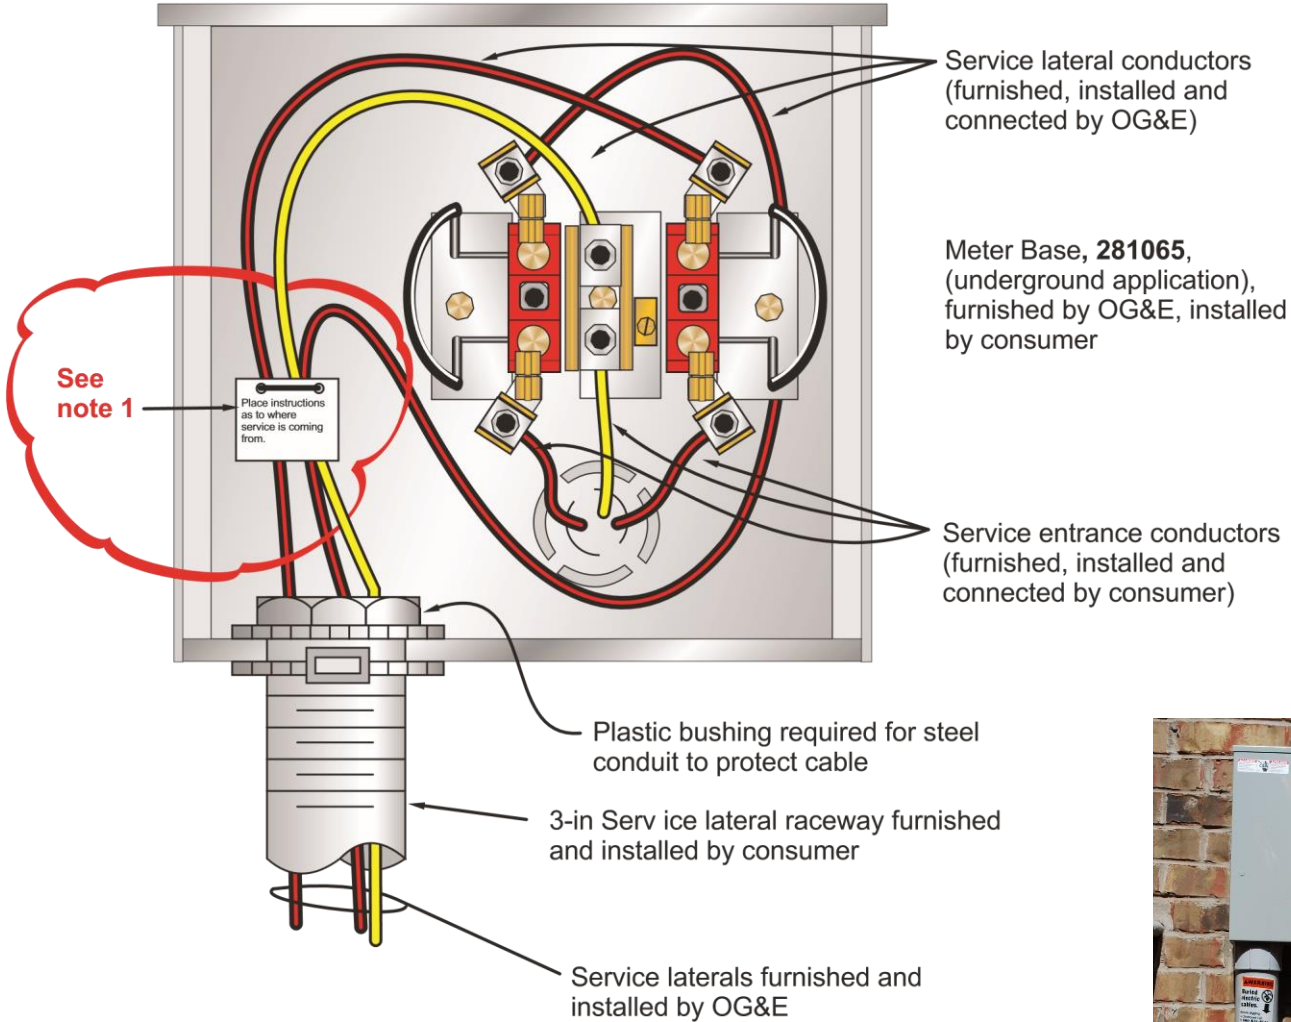

Notes:

1. Place identifying tag on service conductors with information relating to where service is coming from (pedestal, transformer, pipe or no pipe under driveway.) Refer to U16.



The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

CONNECTION DIAGRAM SINGLE PHASE 200-AMPERES MAXIMUM