


Notes:

- A. No distinction shall be made between a mobile home that has its wheels removed or one that is still mobile by virtue of being on a wheeled chassis
- B. The service equipment shall be installed adjacent to the mobile home in all cases
- C. Meter pole location to be approved by OGE
- D. Total length of pole is to be a minimum of 20 feet and diameter of pole at ground line is to be a minimum of 7-inches.
- E. 12-ft over areas restricted to pedestrians or other traffic less than 8-ft in height. 16-ft over areas subject to any traffic greater than 8ft. in height. For swimming pools see D262.4 or D262.6. For other situations see D262, D262.1, D262.3 or D262.5
- F. Use 1/2" thru bolts on top and bottom to mount meter base.

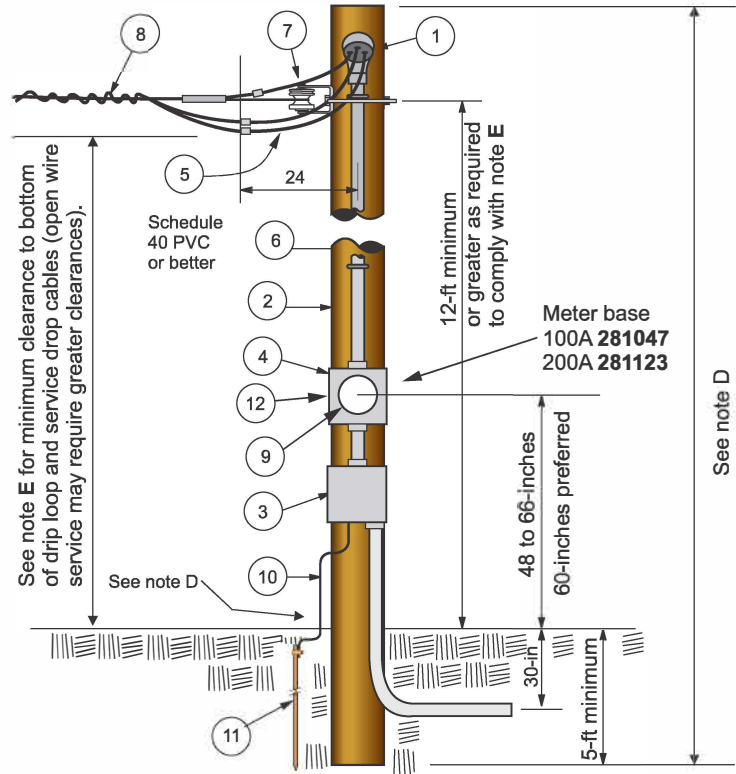

Item no.	Description	Furnished by		Installed by	
		O.G.E.	Consumer	O.G.E.	Consumer
1	Service head		X		X
± 2	Service pole See note D		X		X
3	Service equipment		X		X
4	Meter base	X			X
5	Service entrance conductor		X		X
6	Service raceway		X		X
7	Service drop bracket	X			X
8	Service drop	X		X	
9	Meter	X		X	
10	Grounding electrode Conductor		X		X
11	Grounding electrode		X		X
12	1/2" Mounting bolts See note F		X		X

± Pressure treated southern yellow pine

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates, disclaim any and all liability for the construction or maintenance practices relating to such suggested configuration. Each individual, company, or entity engaging the work associated with this configuration bears full responsibility for its, his, or her own occupational training, and compliance with all applicable local, state, and national laws and regulations. The configuration is not intended to replace the training, know-how, or instruction that may be needed for safe construction or maintenance.

APPROVED Signatures on File

SUPERSEDES JUL 2018 ISSUE

CONSUMER SERVICE POLE
FOR MOBILE HOME PARK 200-AMPERE MAXIMUM PER METER