


U771

NOTES:

- A. Consumer shall leave 6-ft of cable beyond point Z
- B. Use Schedule 40 PVC or better
- C. Refer to U748 and U748.1 for details on terminations in pedestal
- D. Conduit should extend a minimum of 18-inches below grade

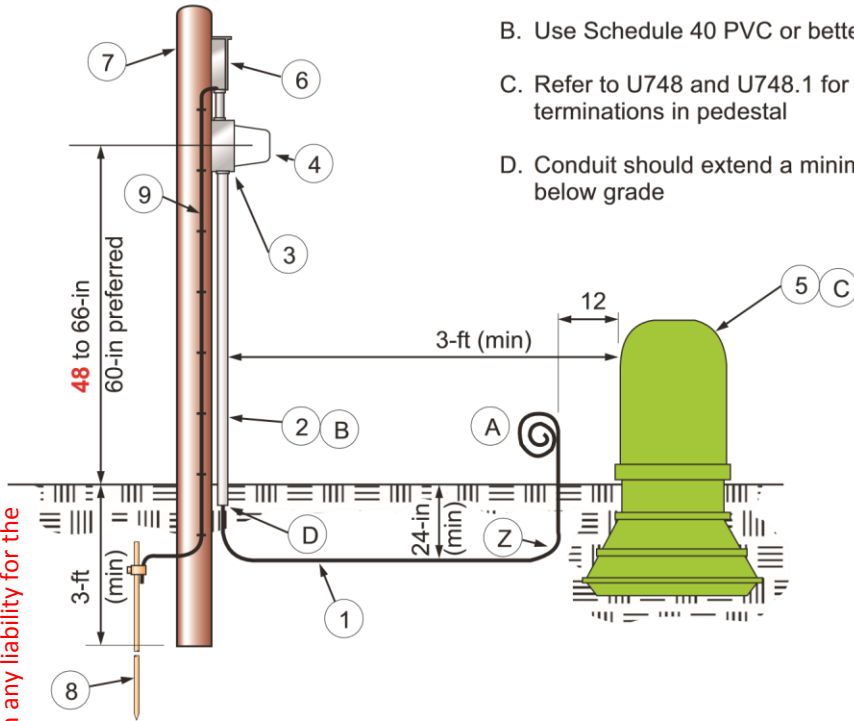

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

ITEM NUMBER	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G.&E.	CONSUMER	O.G.&E.	CONSUMER
1	Temporary Service Lateral		X		X
2	Service Lateral Raceway		X		X
3	Meter Base	X			X
4	Meter	X		X	
5	Service Pedestal	X		X	
6	Service Equipment		X		X
7	Treated Support		X		X
8	Grounding Electrode		X		X
9	Grounding Electrode Conductor		X		X

TEMPORARY SERVICE 3-WIRE, SINGLE-PHASE 240/120-VOLTS