


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates, disclaim any and all liability for the construction or maintenance practices relating to such suggested configuration. Each individual, company, or entity engaging the work associated with this configuration bears full responsibility for its, his, or her own occupational training, and compliance with all applicable local, state, and national laws and regulations. The configuration is not intended to replace the trainin know-how or instruction that ma be needed for safe construction or maintenance.

# D731.3

DISTRIBUTION STANDARD  
VERSION C - FEB 2024

Oklahoma Gas and Electric Company ©

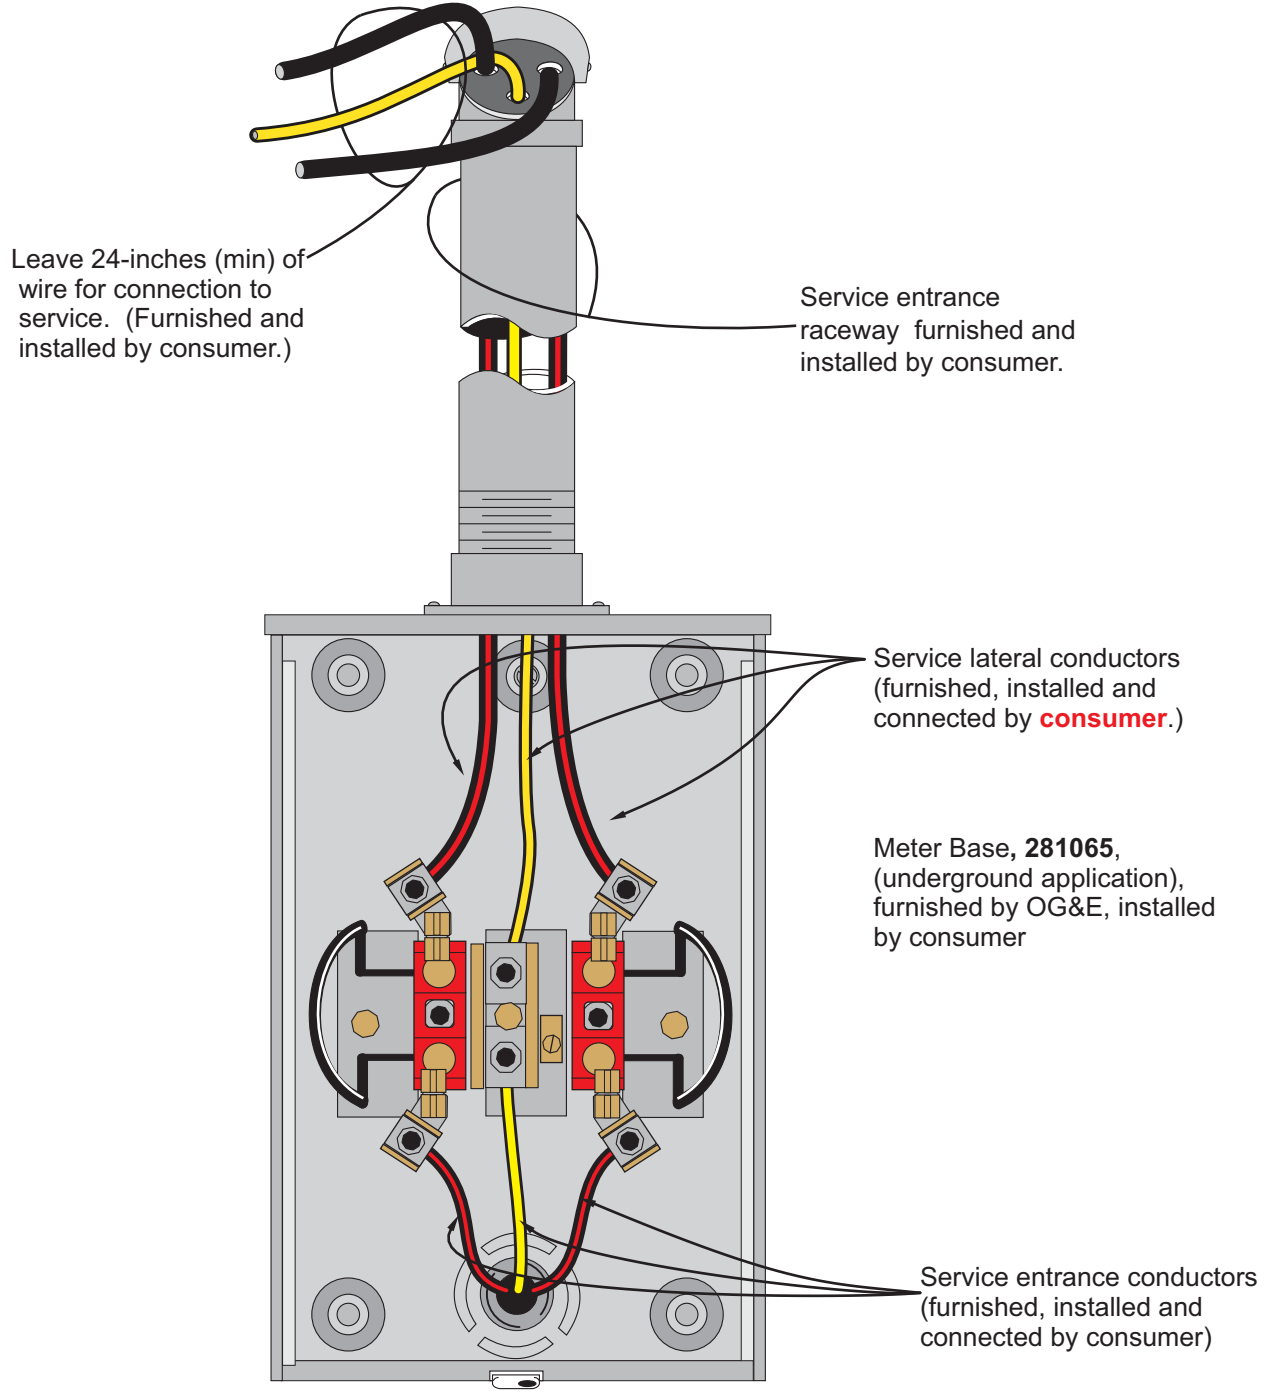

**CONNECTION DIAGRAM**  
SINGLE PHASE      200 AMPERE MINIMUM

ISSUE SUPERSEDES AUG 2005 ISSUE  
APPROVED