


D732.3

DISTRIBUTION STANDARD
FEB 2007

OG&E Electric Services ©

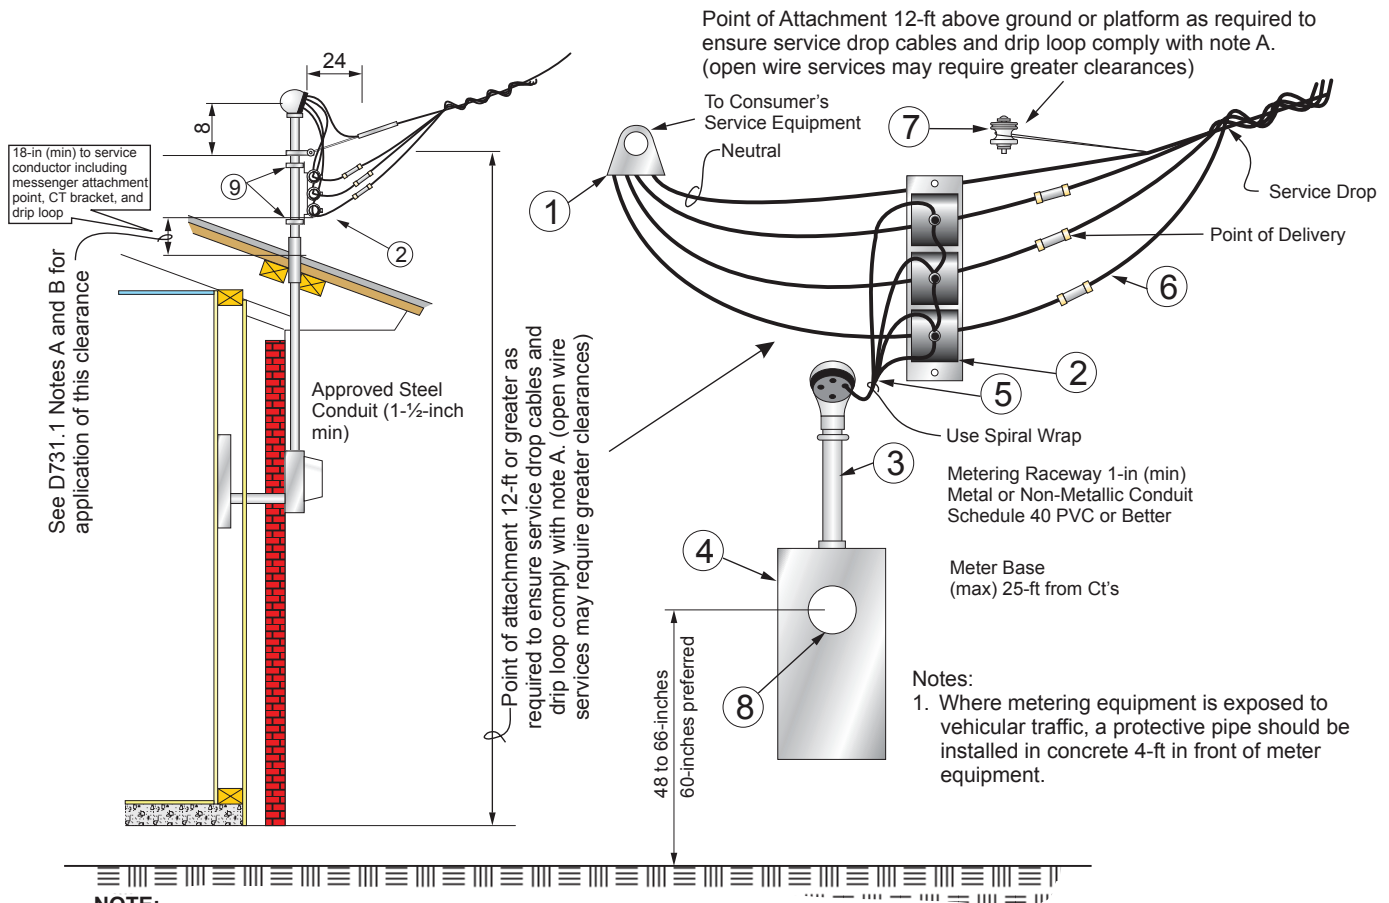

NOTE:

- A. 12-ft over areas restricted to pedestrians or other traffic less than 8-ft in height.
16-ft **over areas subject to any traffic greater than 8ft. in height.**
For swimming pools see D262.4 or D262.6.
For other situations see D262, D262.1, D262.4 or D262.5.

ITEM NO.	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G. & E.	CONSUMER	O.G. & E.	CONSUMER
1	SERVICE HEAD		X		X
2	CURRENT TRANSFORMERS AND MOUNTING BRACKET	X			X
3	METERING RACEWAY AND WEATHERHEAD		X		X
4	METER BASE	X			X
5	METER WIRING	X		X	
6	SERVICE ENTRANCE CONDUCTOR		X		X
7	SERVICE DROP BRACKET	X			X
8	METER	X		X	
9	2 CLAMPS	X			X


SERVICE ENTRANCE AND OUTDOOR METERING INSTALLATION ABOVE 200-AMPERES 4 WIRE, POLY-PHASE, 240-delta/120, 208Y/120 OR 480/277-VOLTS

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

SUPERSEDES NOV 2006 ISSUE

APPROVED **Signatures on File**

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

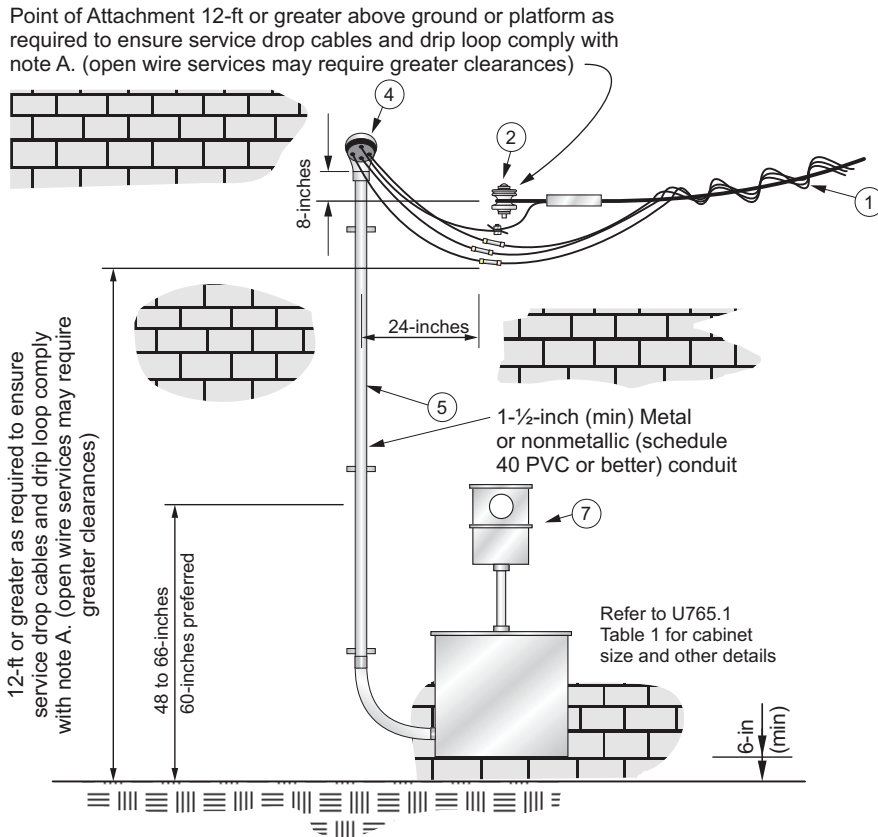

NOTE:

- A. 12-ft over areas restricted to pedestrians or other traffic less than 8-ft in height.
- 16-ft **over areas subject to any traffic greater than 8ft. in height.**
- For swimming pools see D262.4 or D262.6.
- For other situations see D262, D262.1, D262.4 or D262.5.
- For possible reduced clearance requirements for RESIDENTIAL SINGLE STORY buildings see NESC Table 232-1 footnotes 7 and 8.

ITEM NO.	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G.& E.	CONSUMER	O.G.& E.	CONSUMER
1	SERVICE DROP	X		X	
2	SERVICE DROP BRACKET	X			X
3	SERVICE ENTRANCE CONDUCTOR		X		X
4	SERVICE HEAD		X		X
5	SERVICE RACEWAY		X		X
6	SERVICE EQUIPMENT		X		X
7	METER BASE	X			X
8	SELF-CONTAINED METER	X		X	
9	GROUNDING ELECTRODE CONDUCTOR		X		X
10	GROUNDING ELECTRODE		X		X

Signatures on File

APPROVED
FIRST ISSUE

METER INSTALLATION
FOR CURRENT TRANSFORMER METERING
SINGLE OR THREE PHASE 1200-AMPERES MAXIMUM