


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates, disclaim any and all liability for the construction or maintenance practices relating to such suggested configuration. Each individual, company, or entity engaging the work associated with this configuration bears full responsibility for its, his, or her own occupational training, and compliance with all applicable local, state, and national laws and regulations. The configuration is not intended to replace the training, know-how, or instruction that may be needed for safe construction or maintenance.

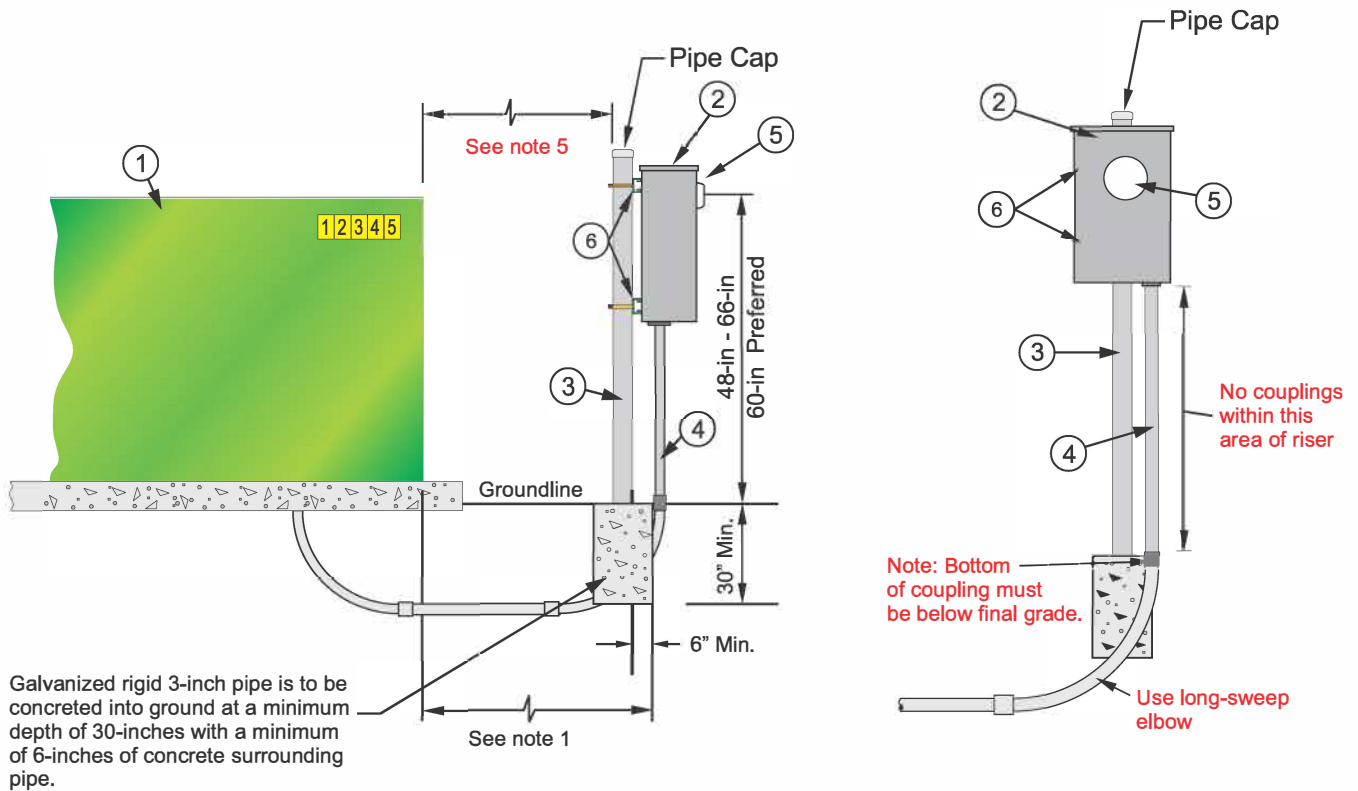

Galvanized rigid 3-inch pipe is to be concreted into ground at a minimum depth of 30-inches with a minimum of 6-inches of concrete surrounding pipe.

ITEM Number	DESCRIPTION	FURNISHED BY		INSTALLED BY	
		O.G.&E.	CONSUMER	O.G.&E.	CONSUMER
1	Transformer	X		X	
2	CT Meter Base	X			X
3	3-inch Galvanized Rigid pipe set in concrete		X		X
4*	Metering Conduit 1-inch sch 40 or rigid		X		X
5	Meter	X		X	
6	1 5/8-inch Kindorf and Clamps		X		X

* Riser and elbows to be galvanized steel if in hazardous or high impact areas.

Notes

1. Metering to be on free-standing structure adjacent to transformer pad. CT wiring not to exceed 20 feet in total length.
2. Place cap on top of pipe to keep moisture from inside of pipe to prevent deterioration.
3. Pipe to be galvanized rigid 3-inch pipe. Pipe to be set at a minimum depth of 30-inches with a minimum of 6-inches of concrete surrounding pipe.
3. In order for the meter to be accessible for operation and maintenance, a minimum of 5 feet clearance from all obstructions must be maintained in front of the meter.
4. Refer to U16 for proper identification and marking.
5. Allow sufficient clearance between transformer and meter rack to open transformer door fully.
6. OG&E equipment not to be used for customer grounding.

**CT METERING COMPONENTS
INSTALLATION INSTRUCTIONS
ONE CUSTOMER AND CT'S IN TRANSFORMER
THREE-PHASE ONLY**

SUPERSEDES SEPT 2018 ISSUE

APPROVED