


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

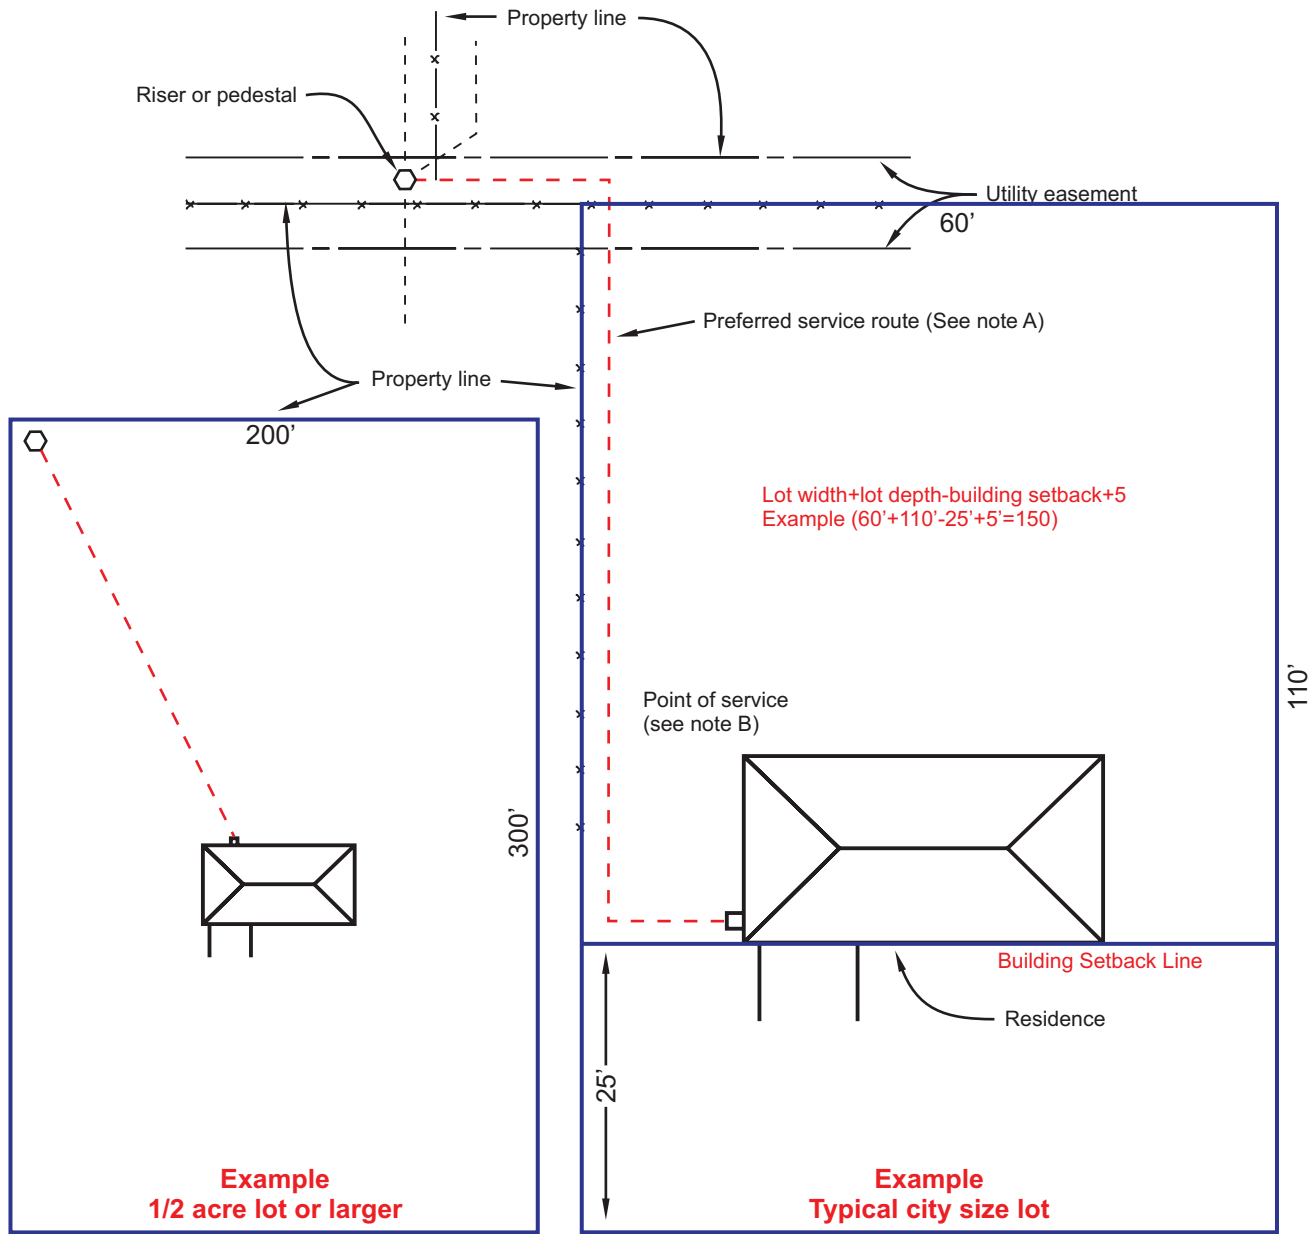

NOTES:

- A. Service route to each consumer should be in the easement and on the consumer's property who will receive service. Service route should not cross other private property unless permanent obstructions prevent installation along preferred route.
- B. OG&E will supply service to a point on the side of the residence nearest the electricity supply system. If, for good reason, the contractor or builder needs to place the service entrance elsewhere the OG&E company should be notified and the alternate location approved before the service entrance is installed.

APPROVED **Signatures on File**
SUPERSEDES APR 1976 ISSUE

**UNDERGROUND SERVICES
PREFERRED ROUTING AND POINT OF SERVICE**