


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

APPROVED **Signatures on File**

SUPERSEDES MAR 2006 ISSUE

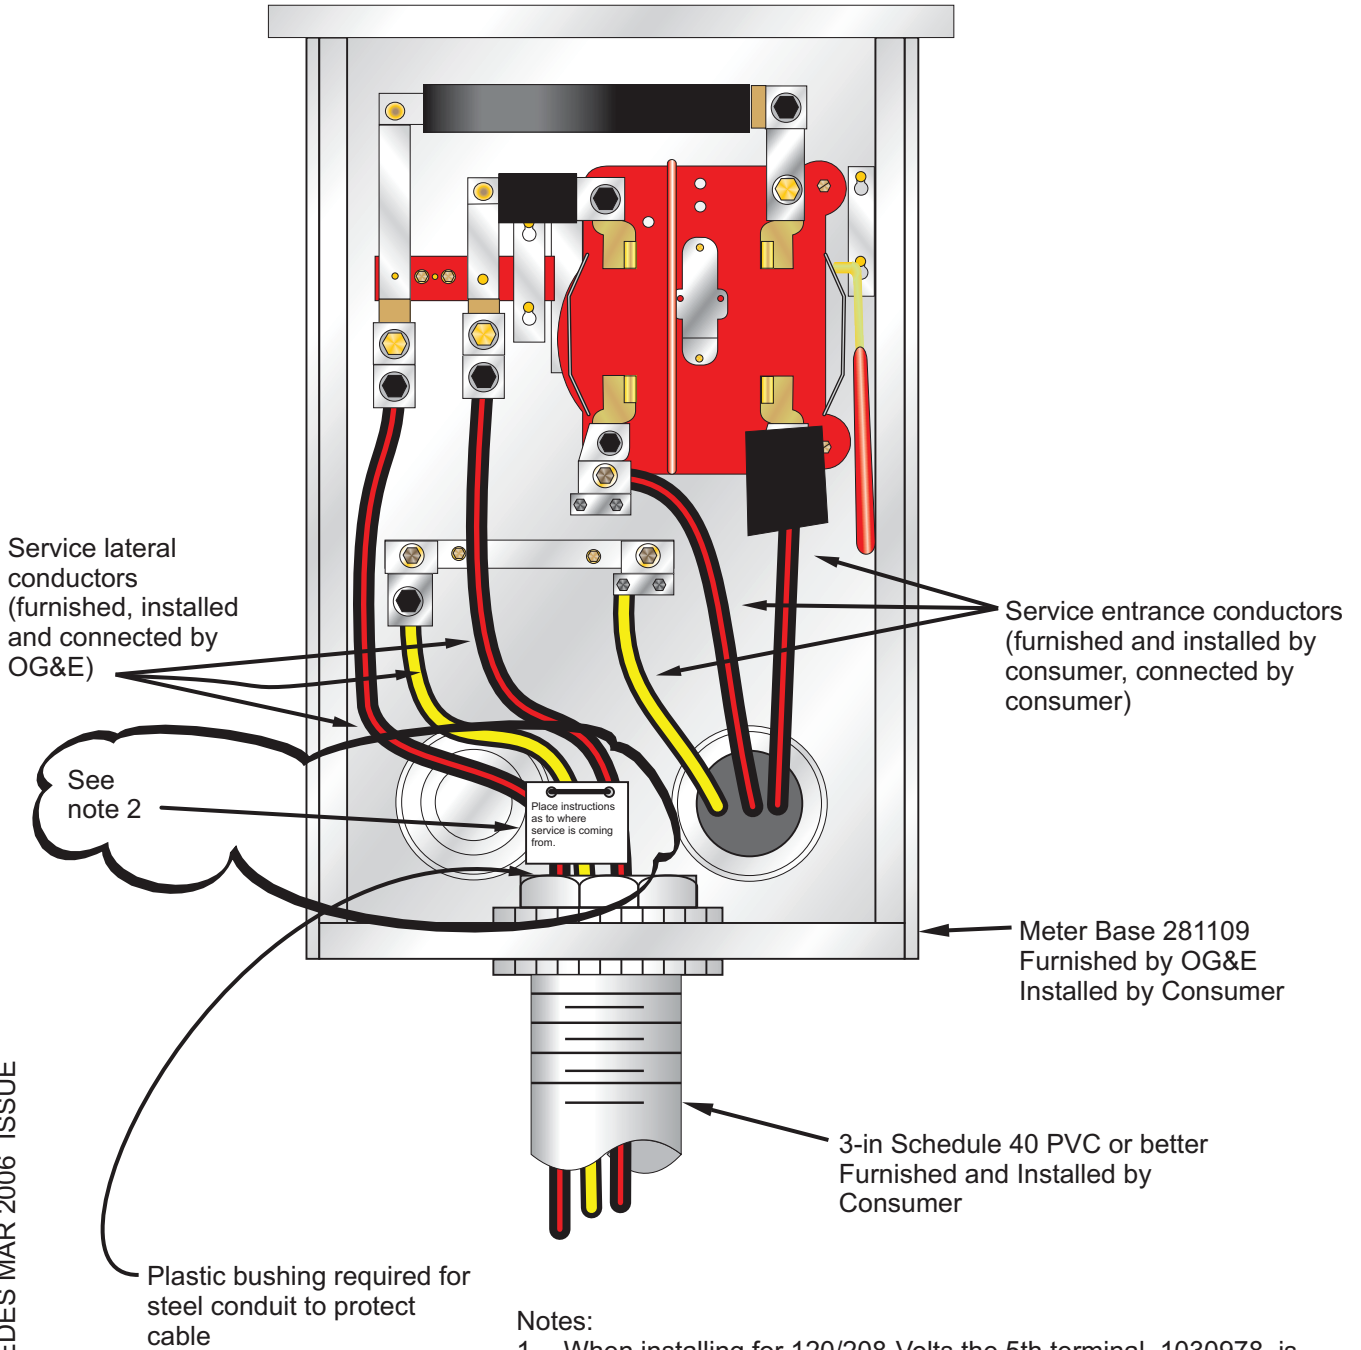

Notes:

1. When installing for 120/208-Volts the 5th terminal, 1030978, is required.
2. Place identifying tag on service conductors with information relating to where service is coming from (pedestal, transformer, pipe or no pipe under driveway.) **Refer to U16.**

CONNECTION DIAGRAM
SINGLE PHASE 320-AMPERES MAXIMUM