


The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OGE Energy Corp., its subsidiaries and affiliates, disclaim any and all liability for the construction or maintenance practices relating to such suggested configuration. Each individual, company, or entity engaging the work associated with this configuration bears full responsibility for its, his, or her own occupational training, and compliance with all applicable local, state, and national laws and regulations. The configuration is not intended to replace the training, know-how, or instruction that may be needed for safe construction or maintenance.

APPROVED

SUPERSEDES SEP 2007 ISSUE

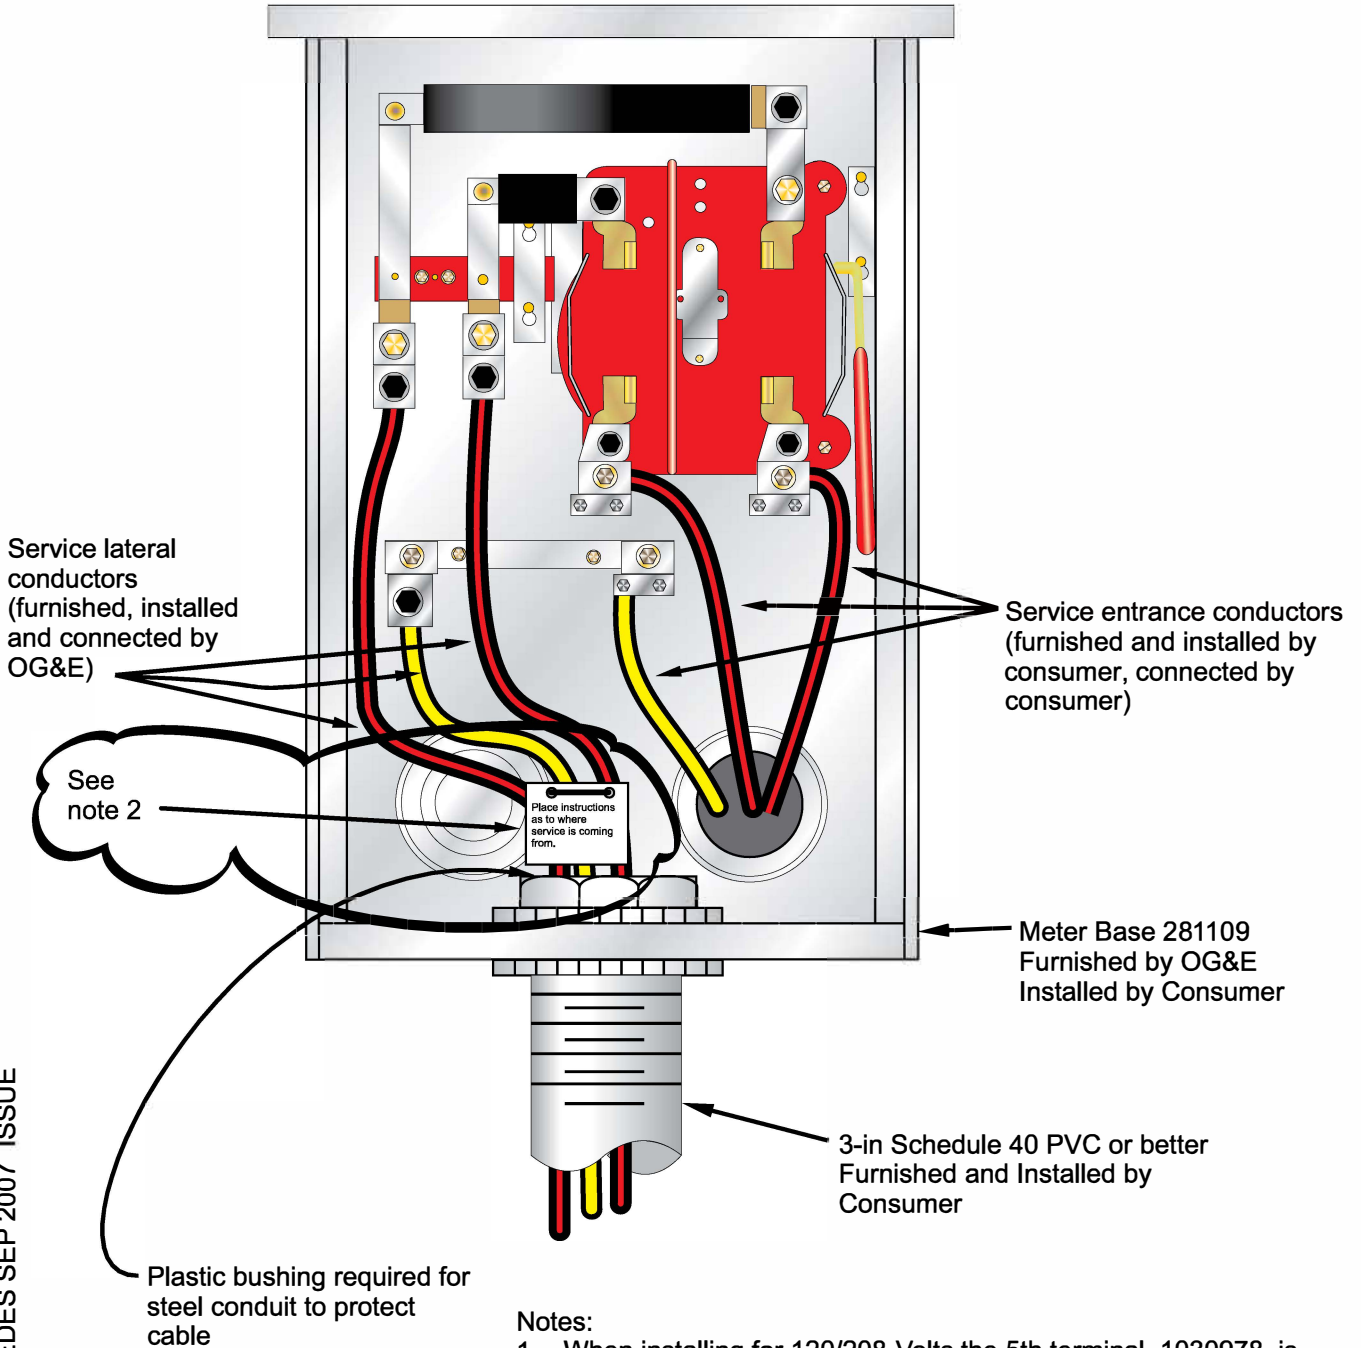

Notes:

1. When installing for 120/208-Volts the 5th terminal, 1030978, is required.
2. Place identifying tag on service conductors with information relating to where service is coming from (pedestal, transformer, pipe or no pipe under driveway.) Refer to U16.

**CONNECTION DIAGRAM**

**SINGLE PHASE, 240 VOLT MAXIMUM, 320-AMPERES MAXIMUM**