


**This Application MUST Meet All  
NEC & AHJ Rules and Regulations**

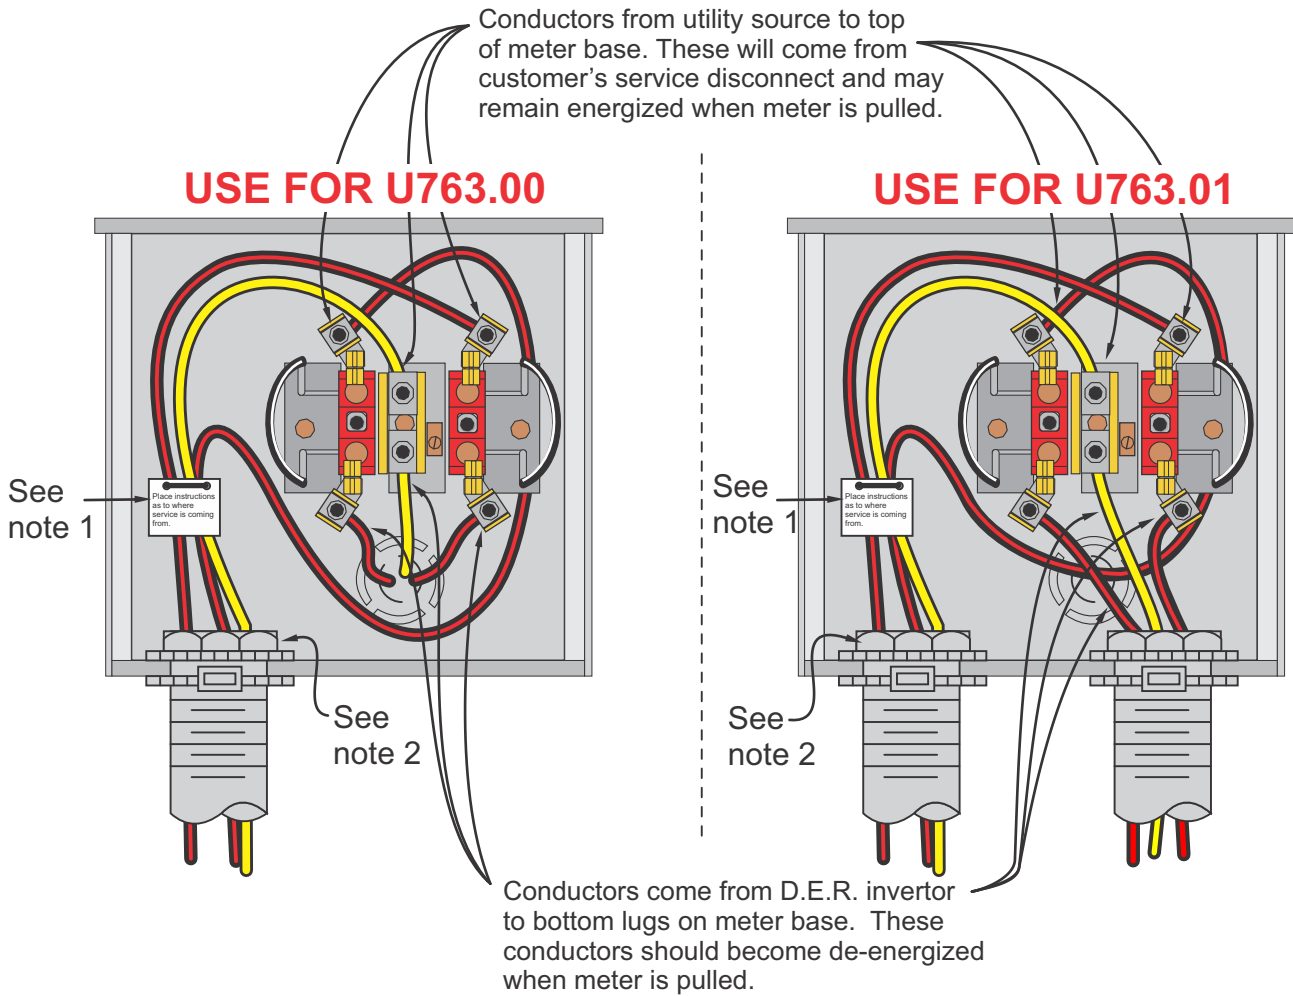

Notes:

1. Place identifying tag on service conductors with information stating the production meter is fed from the NET meter. Refer to U16.
2. Plastic bushing required for conduit to protect cable
3. Meter Base, **281065**, (underground application), furnished by OG&E, installed by consumer.
4. Service lateral raceway to be furnished and installed by consumer.

**PRODUCTION METER  
CONNECTION DIAGRAM  
SINGLE PHASE 200-AMPERES MAXIMUM**

The following is a suggested configuration for meter bases for overhead and underground meters in residential and commercial applications. OG&E Energy Corp., its subsidiaries and affiliates disclaim any liability for the construction or maintenance practices relating to such suggested configuration.

APPROVED Signatures on File